



Boiler Plant Effectiveness Scores Vary Considerably

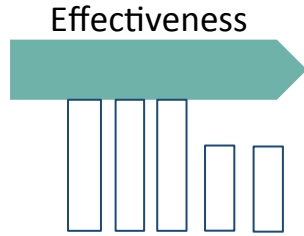

Boiler Plant Effectiveness =
 % of time delivered temp \geq (setpoint - 2.5°C)
 OR
 output of all boilers > 95%

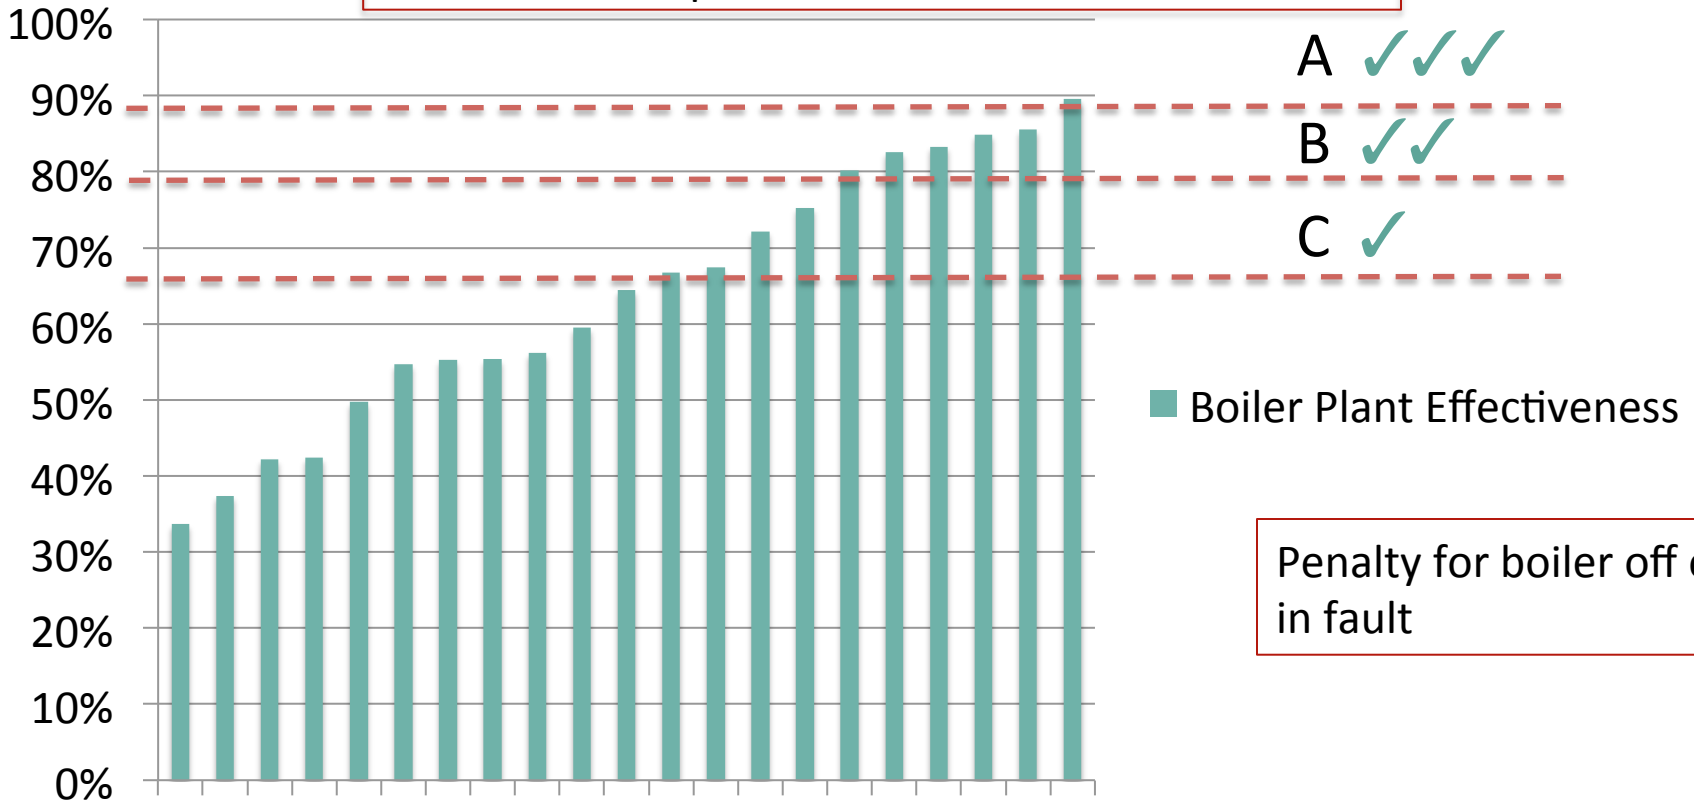

Penalty for boiler off or in fault

Source: A selection of boilers plants monitored by DCM Logic; each bar represents one boiler plant